

INDEPENDENT TESTING SERVICES LIMITED

Testing & Inspection Services to the Civil Engineering Industry

30th June 2016

Our Reference: RM/JV2312/14

L&M Keating
Kilmihill
Co. Clare

Independent Testing Services Limited
5, Main Street
Portarlinton
Co. Laois
Registered in Ireland, No. 368795

Tel: +353(0)57 8642810
Fax: +353(0)57 8642786
Mobile: +353(0)87 9012442

By E-Mail: Rory.Hally@lmkeating.ie

No. of pages: 1

For the attention of Mr. Rory Hally

Vibration Monitoring – Grangegorman Primary Care Centre, Dublin 7.

Dear Rory,

Following our recent visit to the above mentioned site dated 30th June 2016, please find attached 1 no. event report sheet relating to the vibrations recorded since the seismograph was previously downloaded on 1st June 2016. (Seismograph serial No. BE10138).

Seismograph serial No. BE10138 is situated at Monitoring Station No. 1 which is located to the left side of the gate looking out onto Grangegorman Upper.

If you have any queries please feel free to contact us.

Yours sincerely,



Ray Meredith
For and on behalf of Independent Testing Services Limited

Histogram Start Time 11:46:56 June 1, 2016
Histogram Finish Time 13:28:06 June 30, 2016
Number of Intervals 8372 at 5 minutes
Range Geo :254 mm/s
Sample Rate 1024sps


Serial Number BE10138 V 10.60-8.17 MiniMate Plus
Battery Level 6.9 Volts
Calibration March 12, 2015 by E.M
File Name L138GE92.280

Notes

Post Event Notes

	Tran	Vert	Long	
PPV	0.381	0.381	0.889	mm/s
ZC Freq	64	47	23	Hz
Date	Jun 24 /16	Jun 23 /16	Jun 24 /16	
Time	11:21:56	15:16:56	11:16:56	
Sensorcheck	Passed	Passed	Passed	

Peak Vector Sum 0.907 mm/s on June 24, 2016 at 11:16:56

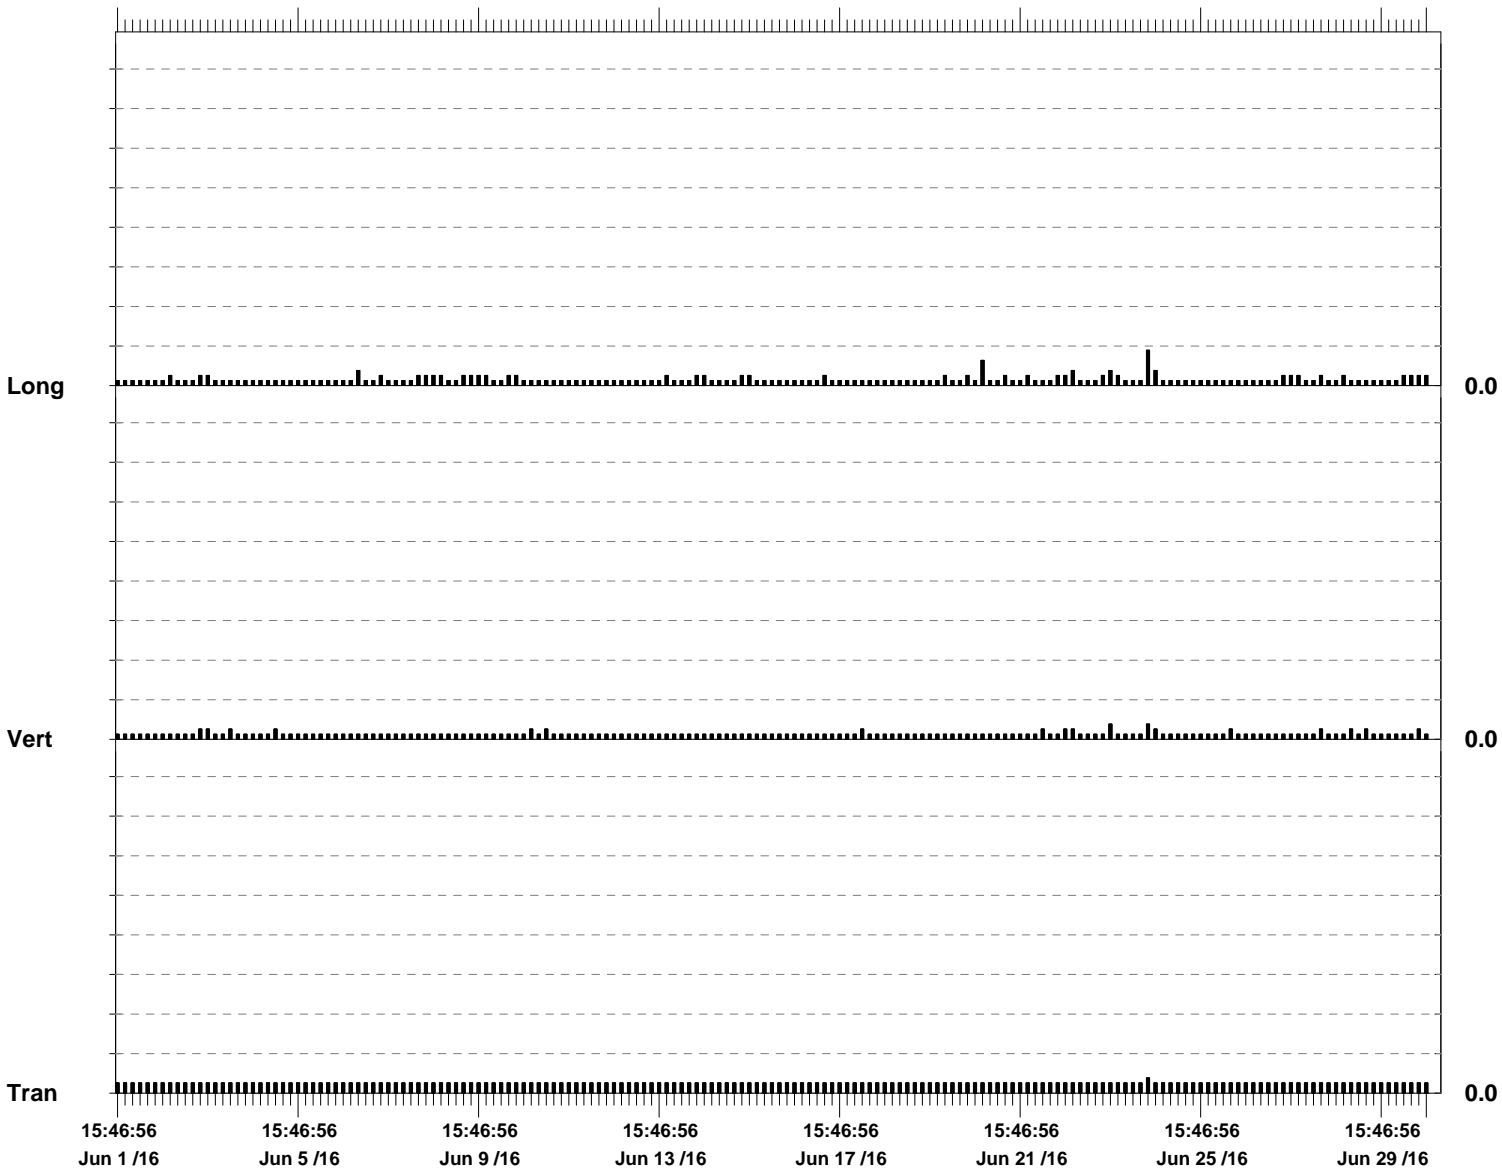

Time Scale: 4 hours /div **Amplitude Scale:**Geo: 1.000 mm/s/div